BUCKEYE WATER DISTRICT NO. 50, INC.
EXISTING SYSTEM - SEPTEMBER 2013

PREPARED BY:

MEYER, MEYER, LaCROIX and HIXSON
ENGINEERS & LAND SURVEYORS
ALEXANDRIA, LOUISIANA

mmLH

RESIDUAL PRESSURES WITH SYSTEM DEMAND AT 0.50 GPM'S PER CUSTOMER

LEGEND
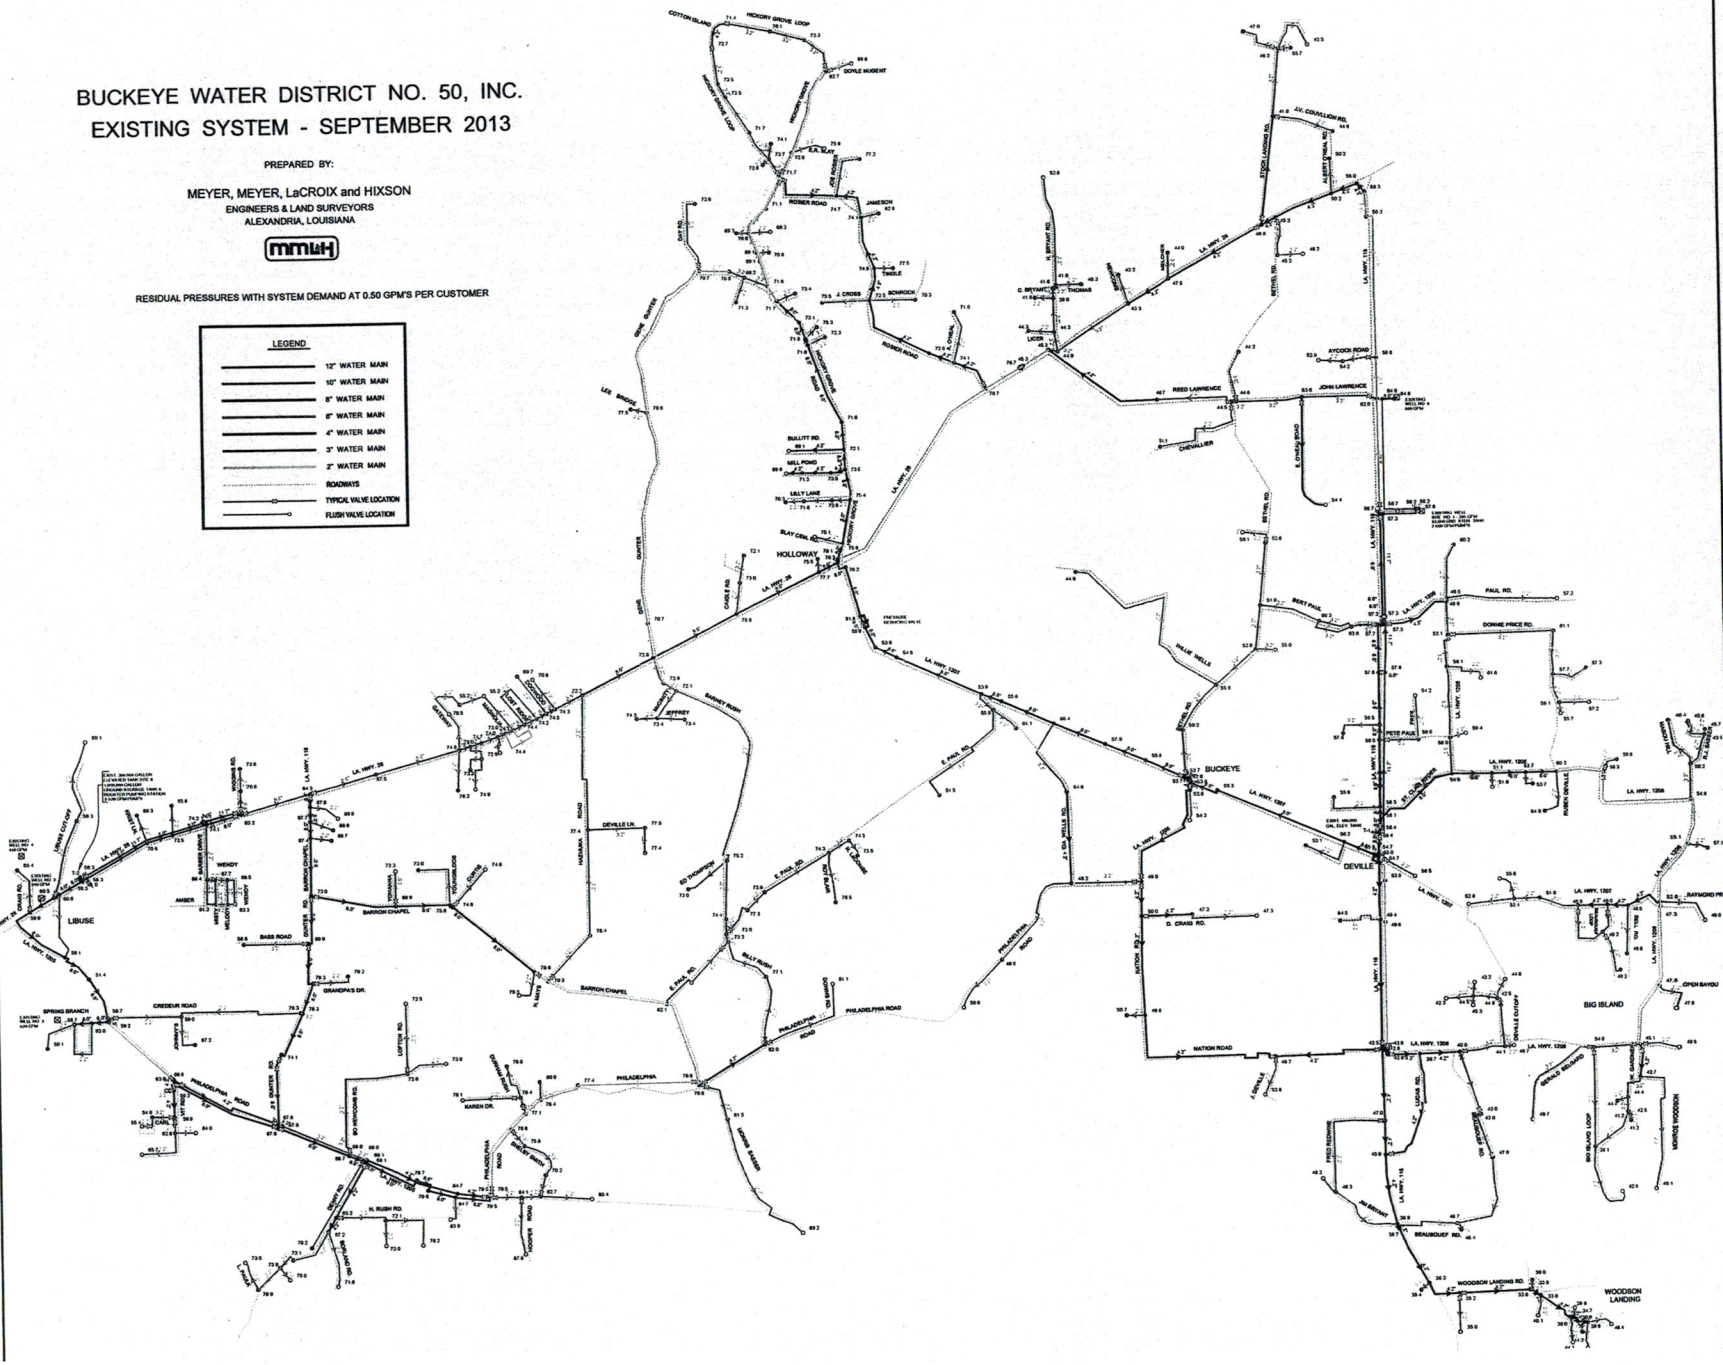
- 12" WATER MAIN
- 10" WATER MAIN
- 8" WATER MAIN
- 6" WATER MAIN
- 4" WATER MAIN
- 3" WATER MAIN
- 2" WATER MAIN
- ROADWAYS
- TYPICAL VALVE LOCATION
- FLUSH VALVE LOCATION